

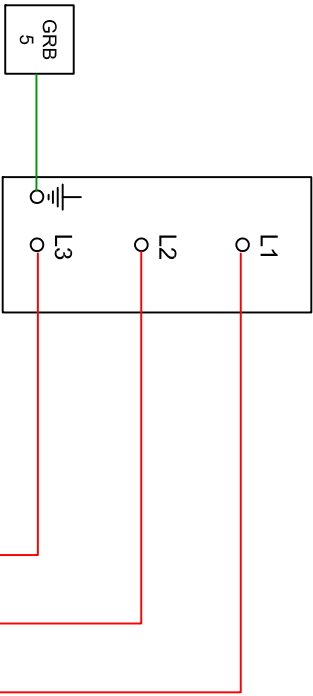


SPD-1

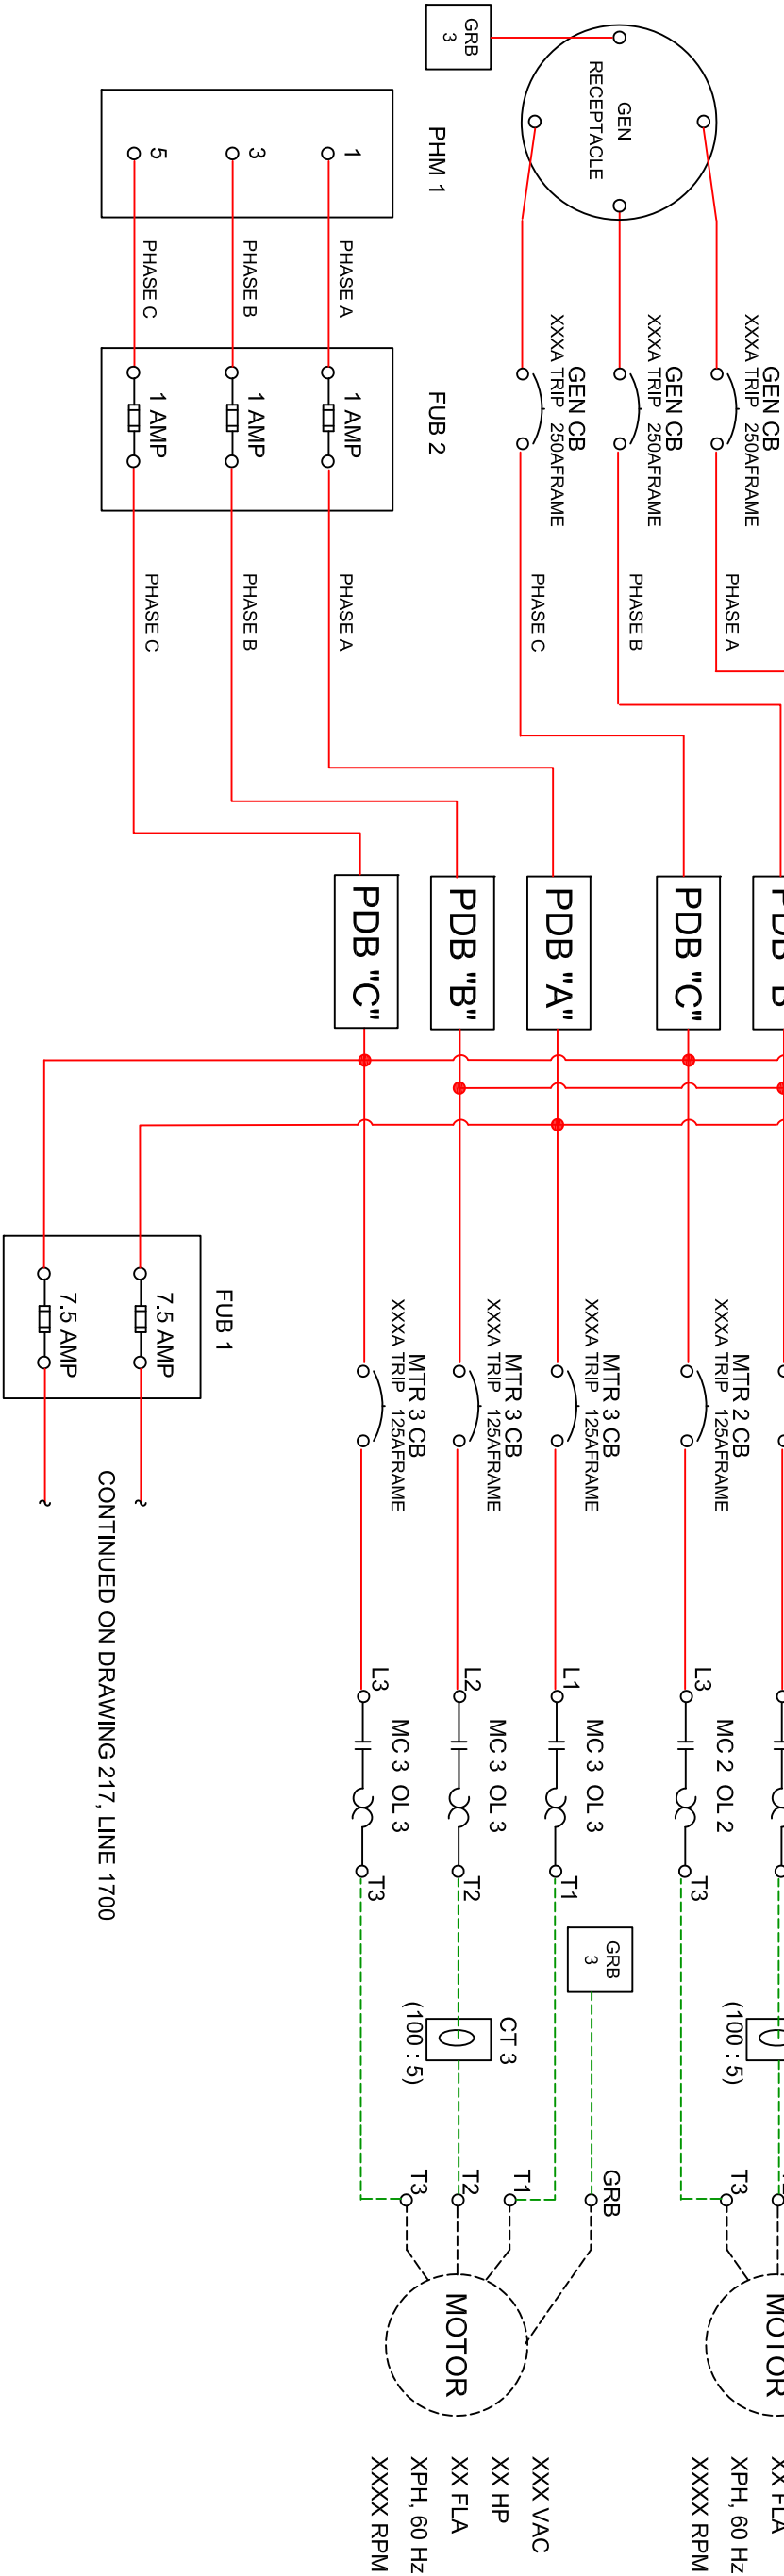

- NOTES:
- FOR OTHER VOLTAGE CONFIGURATIONS, REFER TO MANUFACTURER'S WIRING INSTRUCTIONS. CONTROL POWER TRANSFORMER SHALL BE PROPERLY SIZED FOR APPLICATION. A MINIMUM OF 2000 VA SHALL BE PROVIDED AND MOUNTED EXTERNALLY. REFER TO FRONT ELEVATION AND BILL OF MATERIALS FOR SPECIFIED LOCATION AND SPECIFICATION OF TRANSFORMER.
 - MOTOR CONTROL WIRING LIMITED TO A MAXIMUM OF:
15 HP @ 230 VOLTS
25 HP @ 460 VOLTS

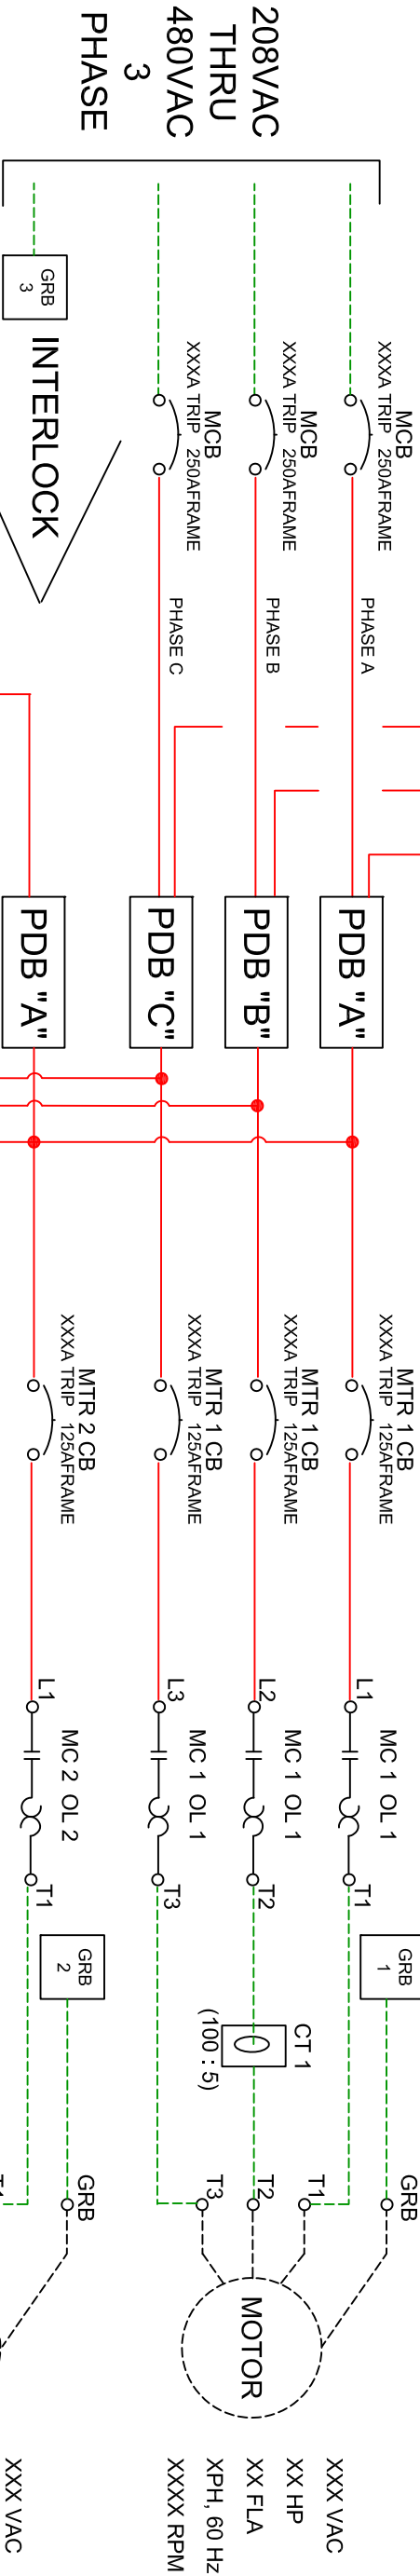

SCALE: N.T.S.	REVISIONS AS PER MEETING		TITLE:	
	DESIGN: JAG / LS		WASTEWATER DIVISION, INDUSTRIAL AUTOMATION GROUP	
	DRAWN BY: JG		CITY OF ORLANDO, FLORIDA	
	APPROVED BY: WW		LIFT STATIONS STANDARDS < 25 HP NEMA STARTER TRIPLEX PCP FOR PORTABLE GENERATOR ONE LINE WIRING SCHEMATIC	
NO		DATE	BY	SHEET 216A