



PANEL GROUNDING TO LOCAL GROUND
COUNTERPOISE WIRING DETAIL

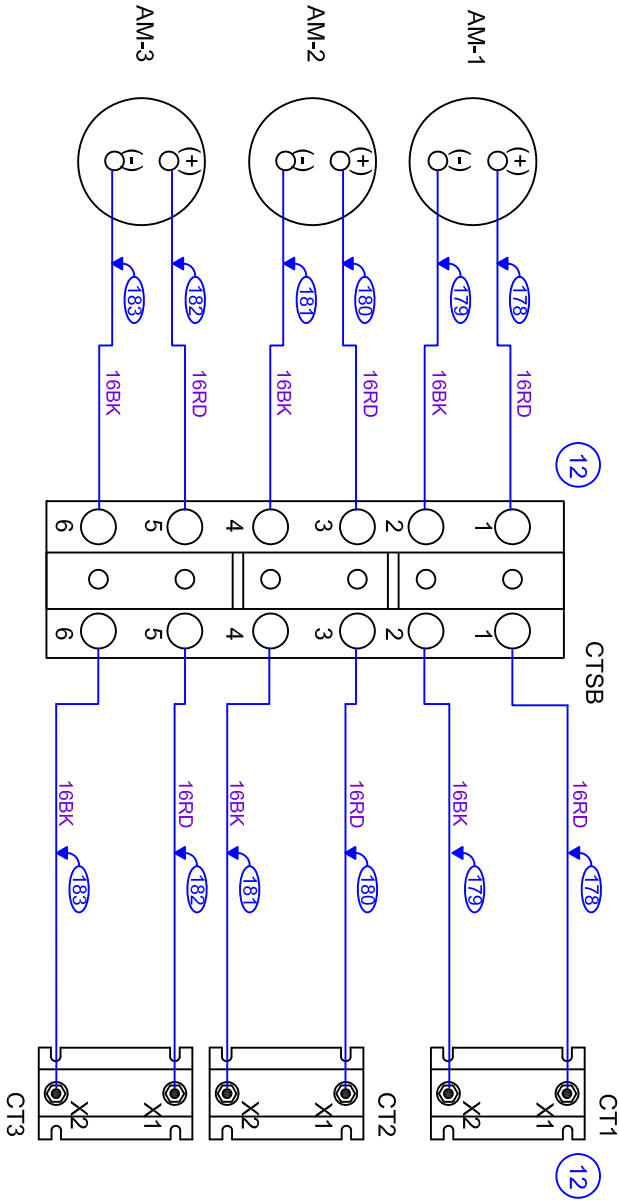

NOTE:
1. "CTSB" WILL BE MOUNTED ON BACK SIDE OF INTERIOR CONTROL PANEL DOOR

2.COMPONENT IDENTIFICATION REFLECTED ON BILL OF MATERIALS
DRAWINGS # 214 AND 215

	SCALE:	N.T.S.	REVISIONS AS PER MEETING		09-03-2013	JG		WASTEWATER DIVISION, INDUSTRIAL AUTOMATION GROUP CITY OF ORLANDO, FLORIDA	TITLE: LIFT STATIONS STANDARDS < 25 HP NEMA STARTER TRIPLEX PCP ENCLOSURE GROUNDING AND METER WIRING DETAILS	SHEET 222
	DESIGN:	IAG / LS								
	DRAWN BY:	JG								
	APPROVED BY:	WW	NO	REVISION	DATE	BY				