NOTES:

1. FOR OTHER VOLTAGE CONFIGURATIONS, REFER TO MANUFACTURER'S WIRING INSTRUCTIONS. CONTROL POWER TRANSFORMER SHALL BE PROPERLY SIZED FOR APPLICATION. A MINIMUM OF 2000 VA SHALL BE PROVIDED AND MOUNTED EXTERNALLY. REFER TO FRONT ELEVATION AND BILL OF MATERIALS FOR SPECIFIED LOCATION AND SPECIFICATION OF TRANSFORMER.

2. MOTOR CONTROL WIRING LIMITED TO A MAXIMUM OF:
15 HP @ 230 VOLTS
25 HP @ 460 VOLTS

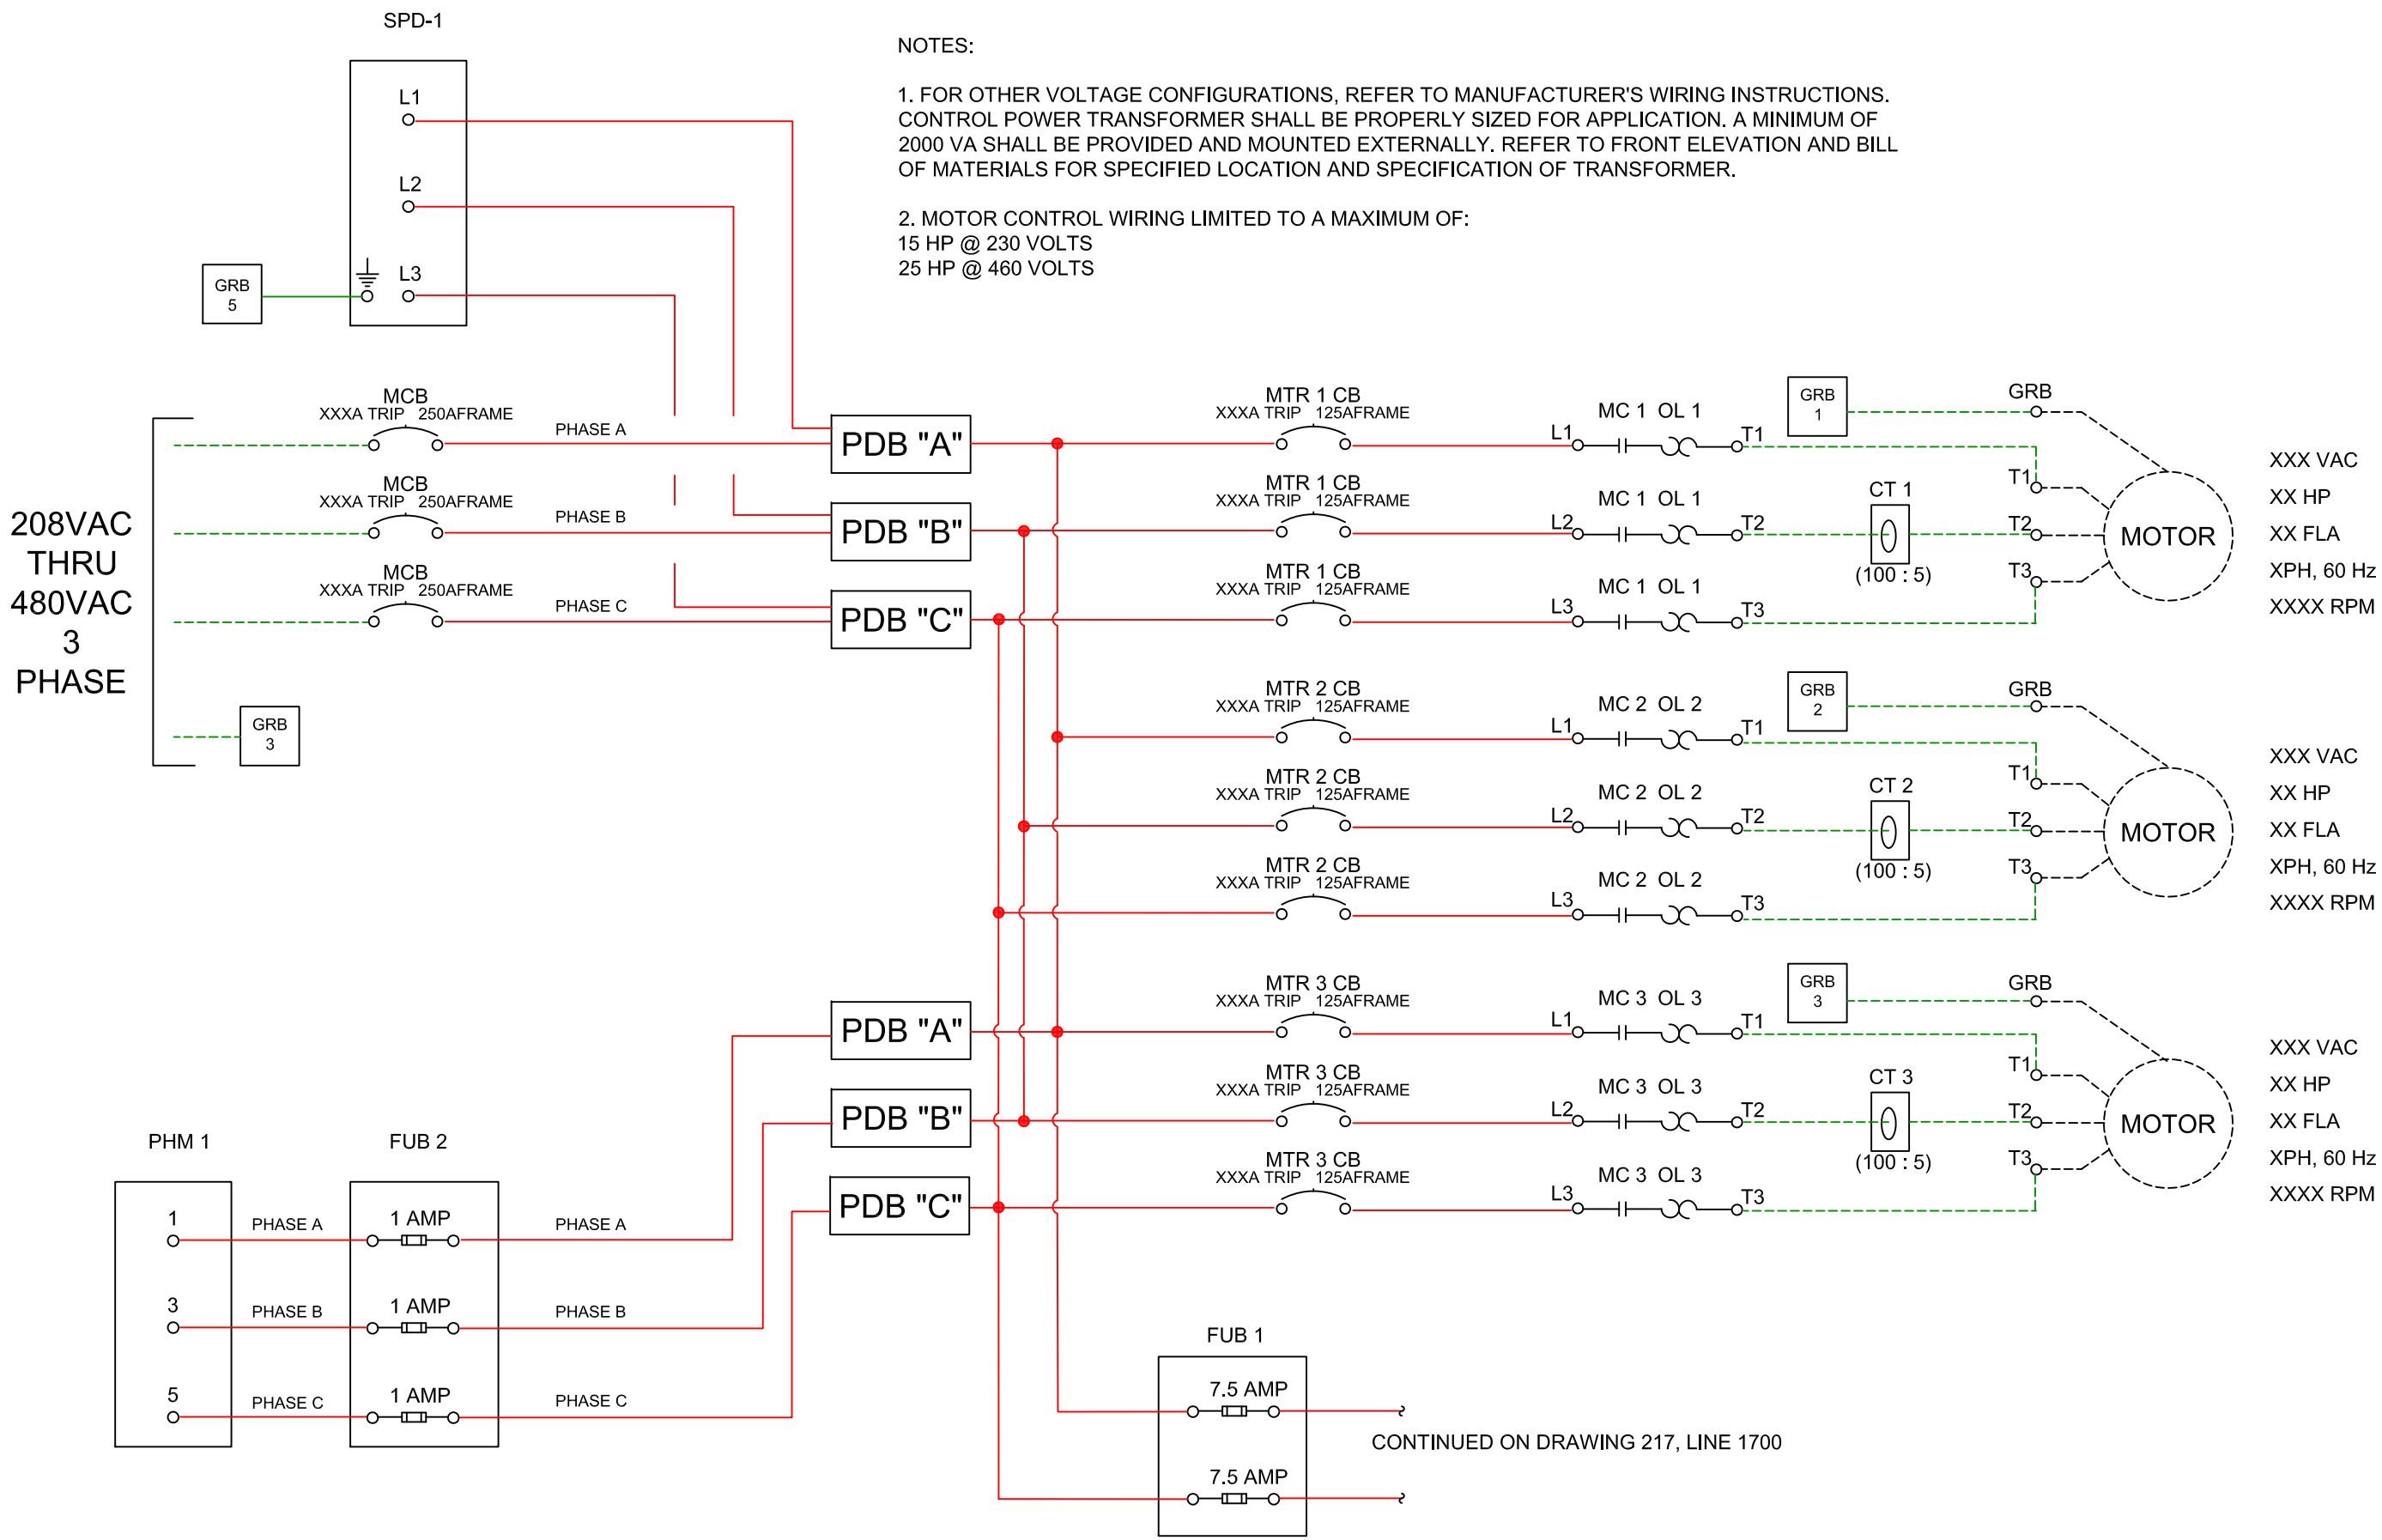

SCALE: N.T.S.	-	REVISIONS AS PER MEETING	08-23-2013	JG	
DESIGN: IAG / LS					
DRAWN BY: JG					
APPROVED BY: WW	NO	REVISION	DATE	BY	

WASTEWATER DIVISION,
INDUSTRIAL AUTOMATION GROUP

CITY OF
ORLANDO, FLORIDA

TITLE:

LIFT STATIONS STANDARDS
< 25 HP NEMA STARTER
TRIPLEX PCP
ONE LINE WIRING SCHEMATIC

SHEET
216B