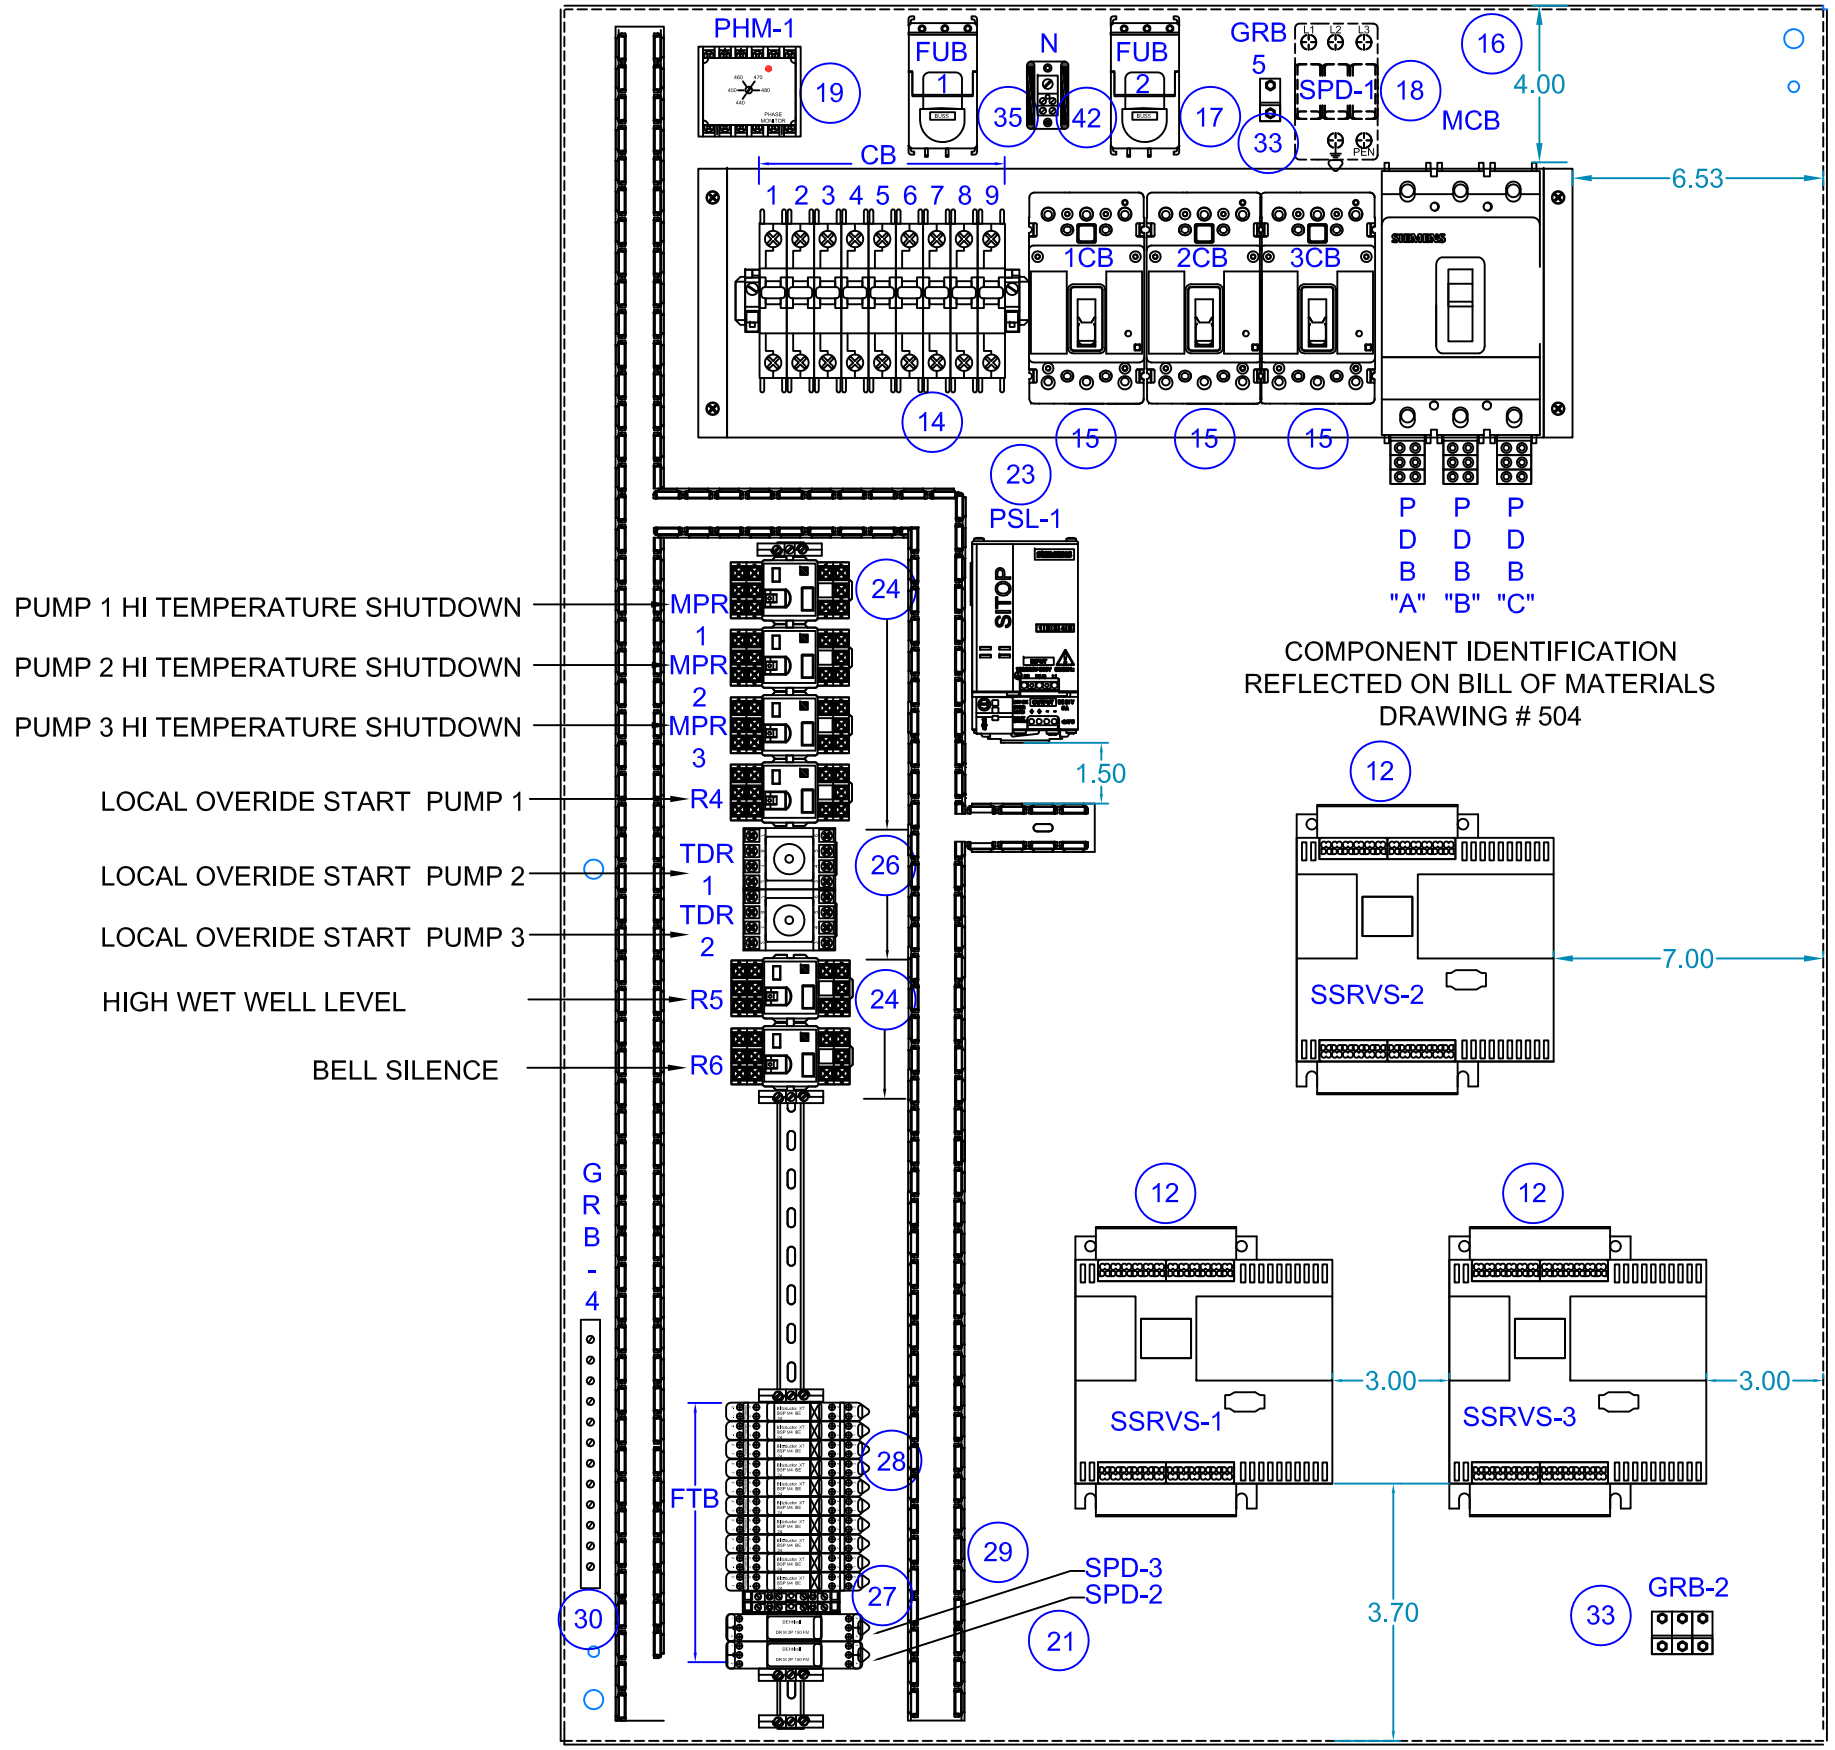

NOTE 1:
MOTOR CONTROL WIRING
LIMITED TO A MAXIMUM OF:
20 HP @ 230 VOLTS
50 HP @ 460 VOLTS

SCALE: N.T.S.	-	REVISIONS AS PER MEETING	09-04-2013	JG	
DESIGN: IAG / LS	-	ADDED ITEM 42	06-26-2014	JG	
DRAWN BY: JG					
APPROVED BY: WW	NO	REVISION	DATE	BY	

WASTEWATER DIVISION,
INDUSTRIAL AUTOMATION GROUP

CITY OF
ORLANDO, FLORIDA

TITLE: LIFT STATIONS STANDARDS
25 HP TO < 50 HP
TRIPLEX SSRVS PUMP CONTROLLER FOR
STATIONERY GENERATOR
INTERIOR PANEL LAYOUT

SHEET
513B