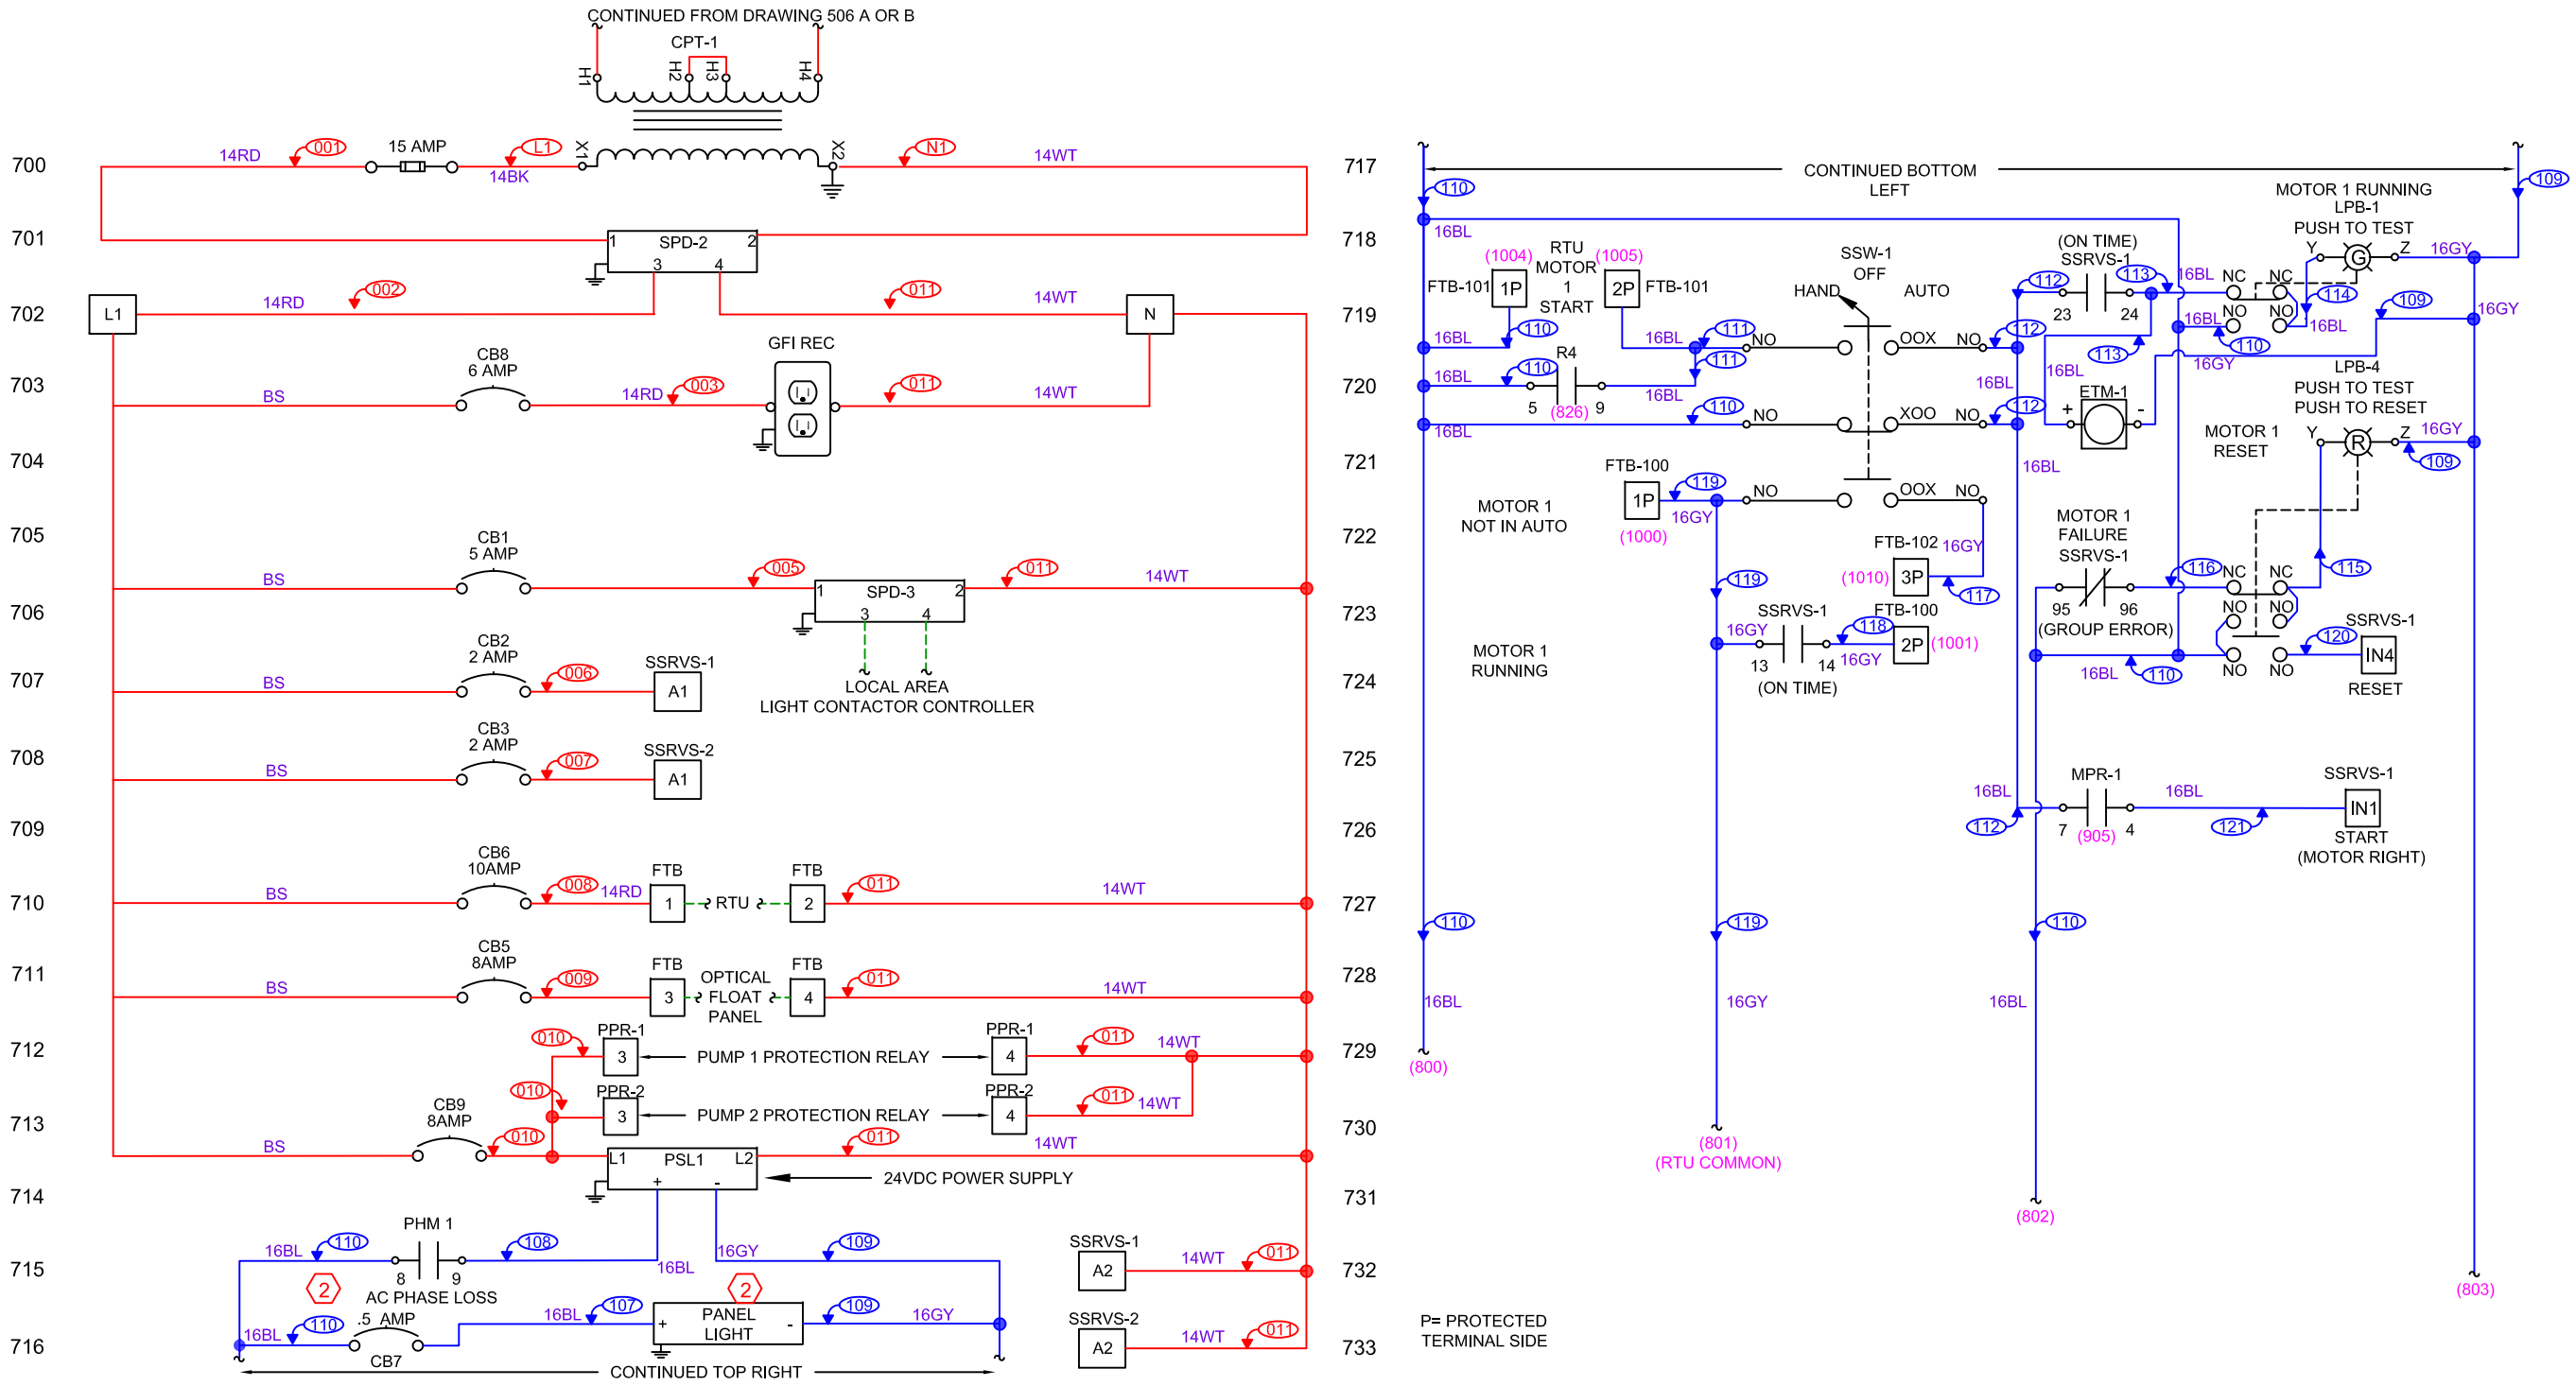

SCALE: N.T.S.	1	ADDED DRAWING LOCATORS	10-25-2013	JG	WASTEWATER DIVISION, INDUSTRIAL AUTOMATION GROUP CITY OF ORLANDO, FLORIDA
DESIGN: IAG / LS	2	REVISED CABINET LTG WIRING AND CB	11-15-2013	JG	
DRAWN BY: JG	3	REVISED TITLE SHEET DESCRIPTION	06-26-2014	JG	
APPROVED BY: WW	4	REVISED CONTROL WIRING TYPOS	06-26-2014	JG	
	5	REVISED TYPOS CIRCUIT BREAKERS	04-10-2015	JG	
	NO	REVISION	DATE	BY	

TITLE: LIFT STATIONS STANDARDS
25 HP TO < 50 HP
DUPLEX SSRVS PUMP CONTROLLER FOR
CONTROL WIRING SCHEMATIC- PART 1

SHEET
507