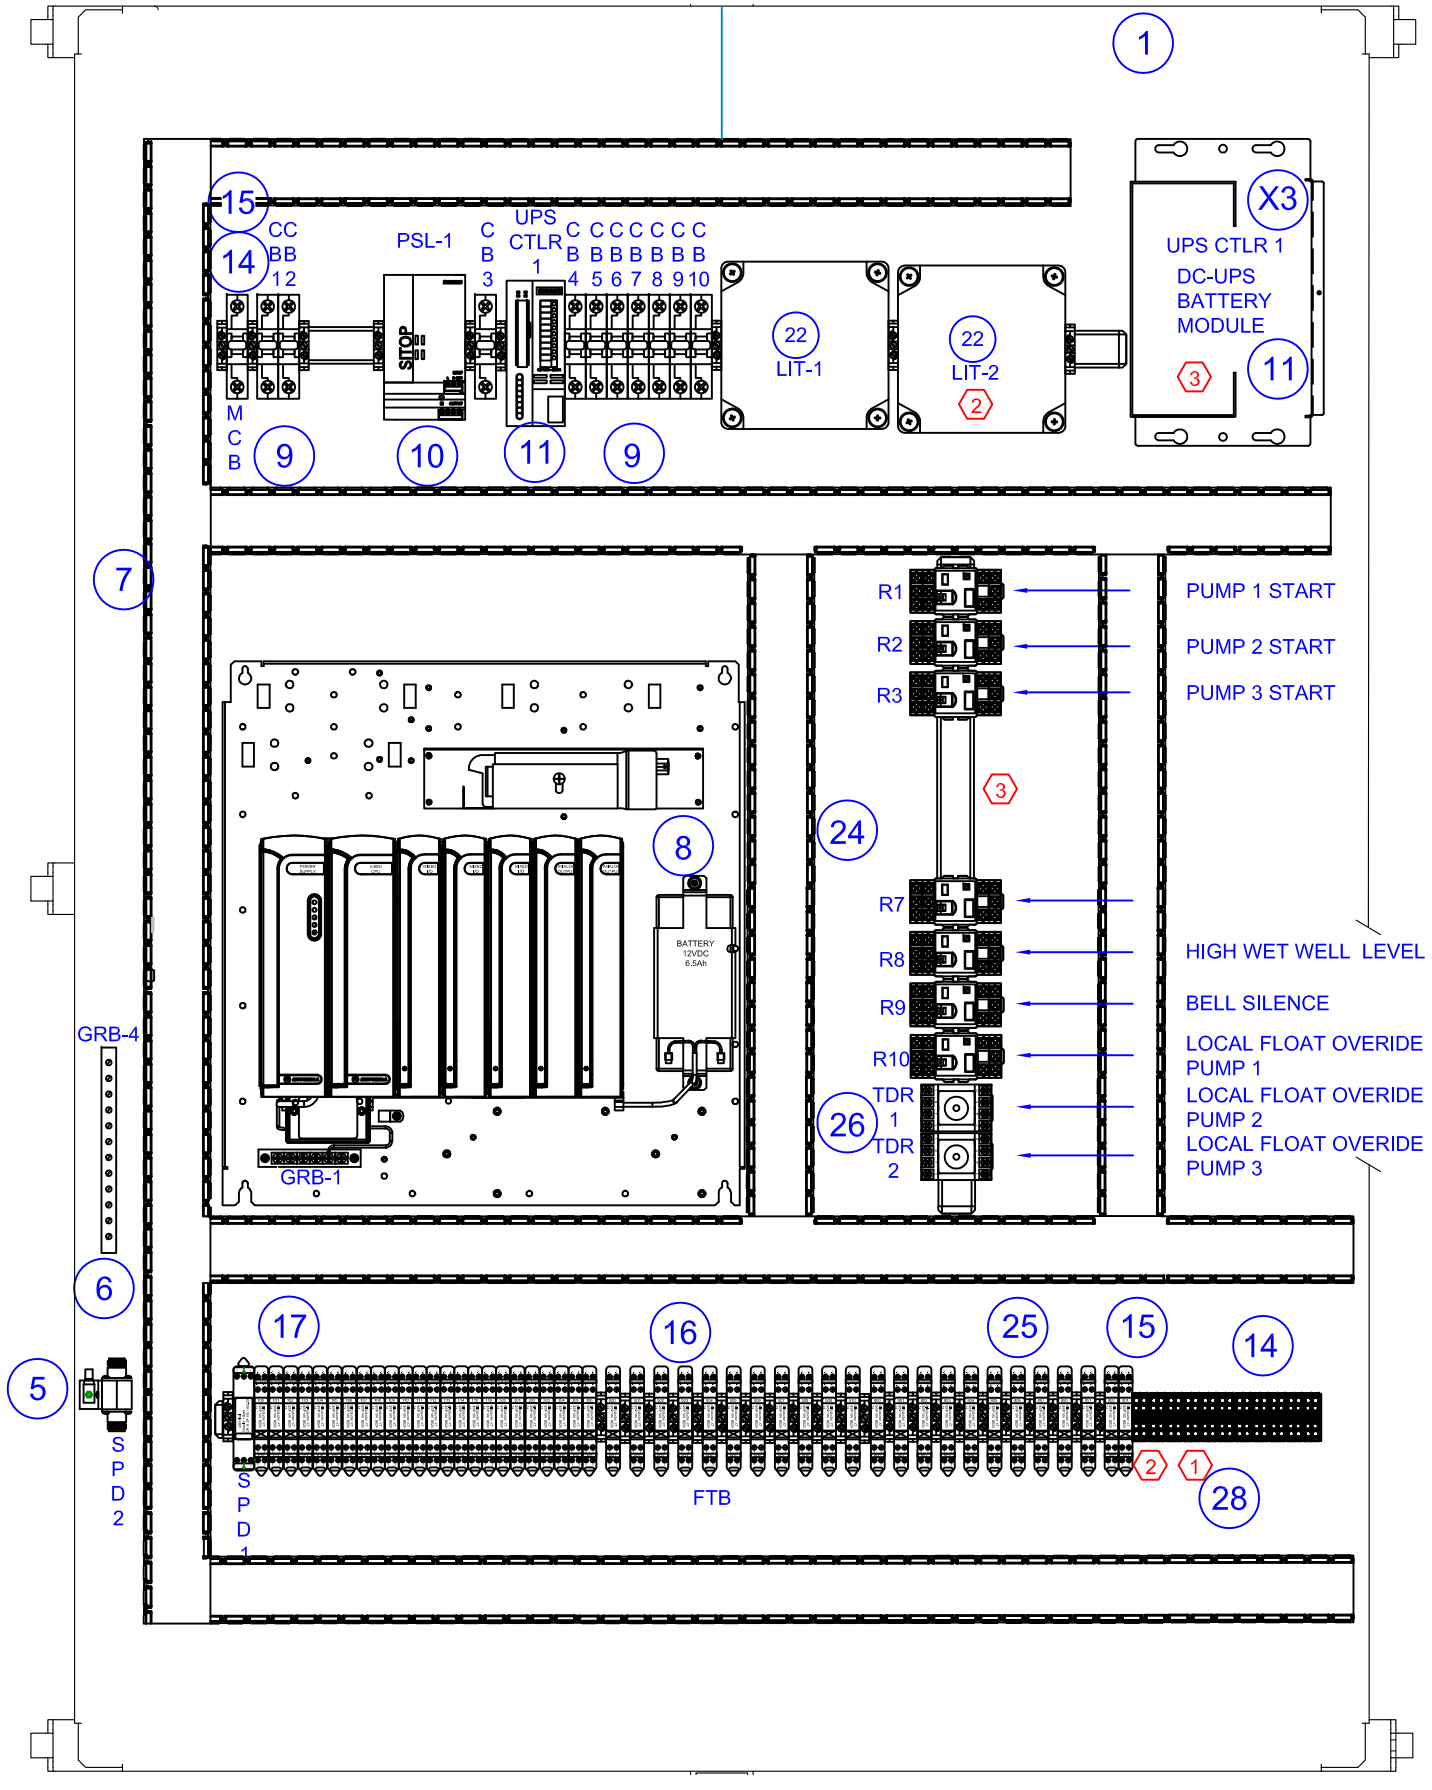

SCALE: N.T.S.	1	REVISIONS AS PER MEETING	03-04-2015	JG	WASTEWATER DIVISION, INDUSTRIAL AUTOMATION GROUP	TITLE: LIFT STATIONS STANDARDS RTU FOR ≥ 50 HP VFD WITH SSRVS PUMP CONTROL PANEL (PCP) INTERIOR LAYOUT
DESIGN: IAG / LS	2	REVISIONS AS PER MEETING	03-04-2015	JG		
DRAWN BY: JG	3	PUMP DISAGREE RELAYS REMOVED	06-15-2015	JG	CITY OF ORLANDO, FLORIDA	SHEET 604
APPROVED BY: WW	3	ADDED UPS BATTERY MODULE FOR LONGER RUN TIME	06-15-2015	JG		
	NO	REVISION	DATE	BY		