P = PROTECTED

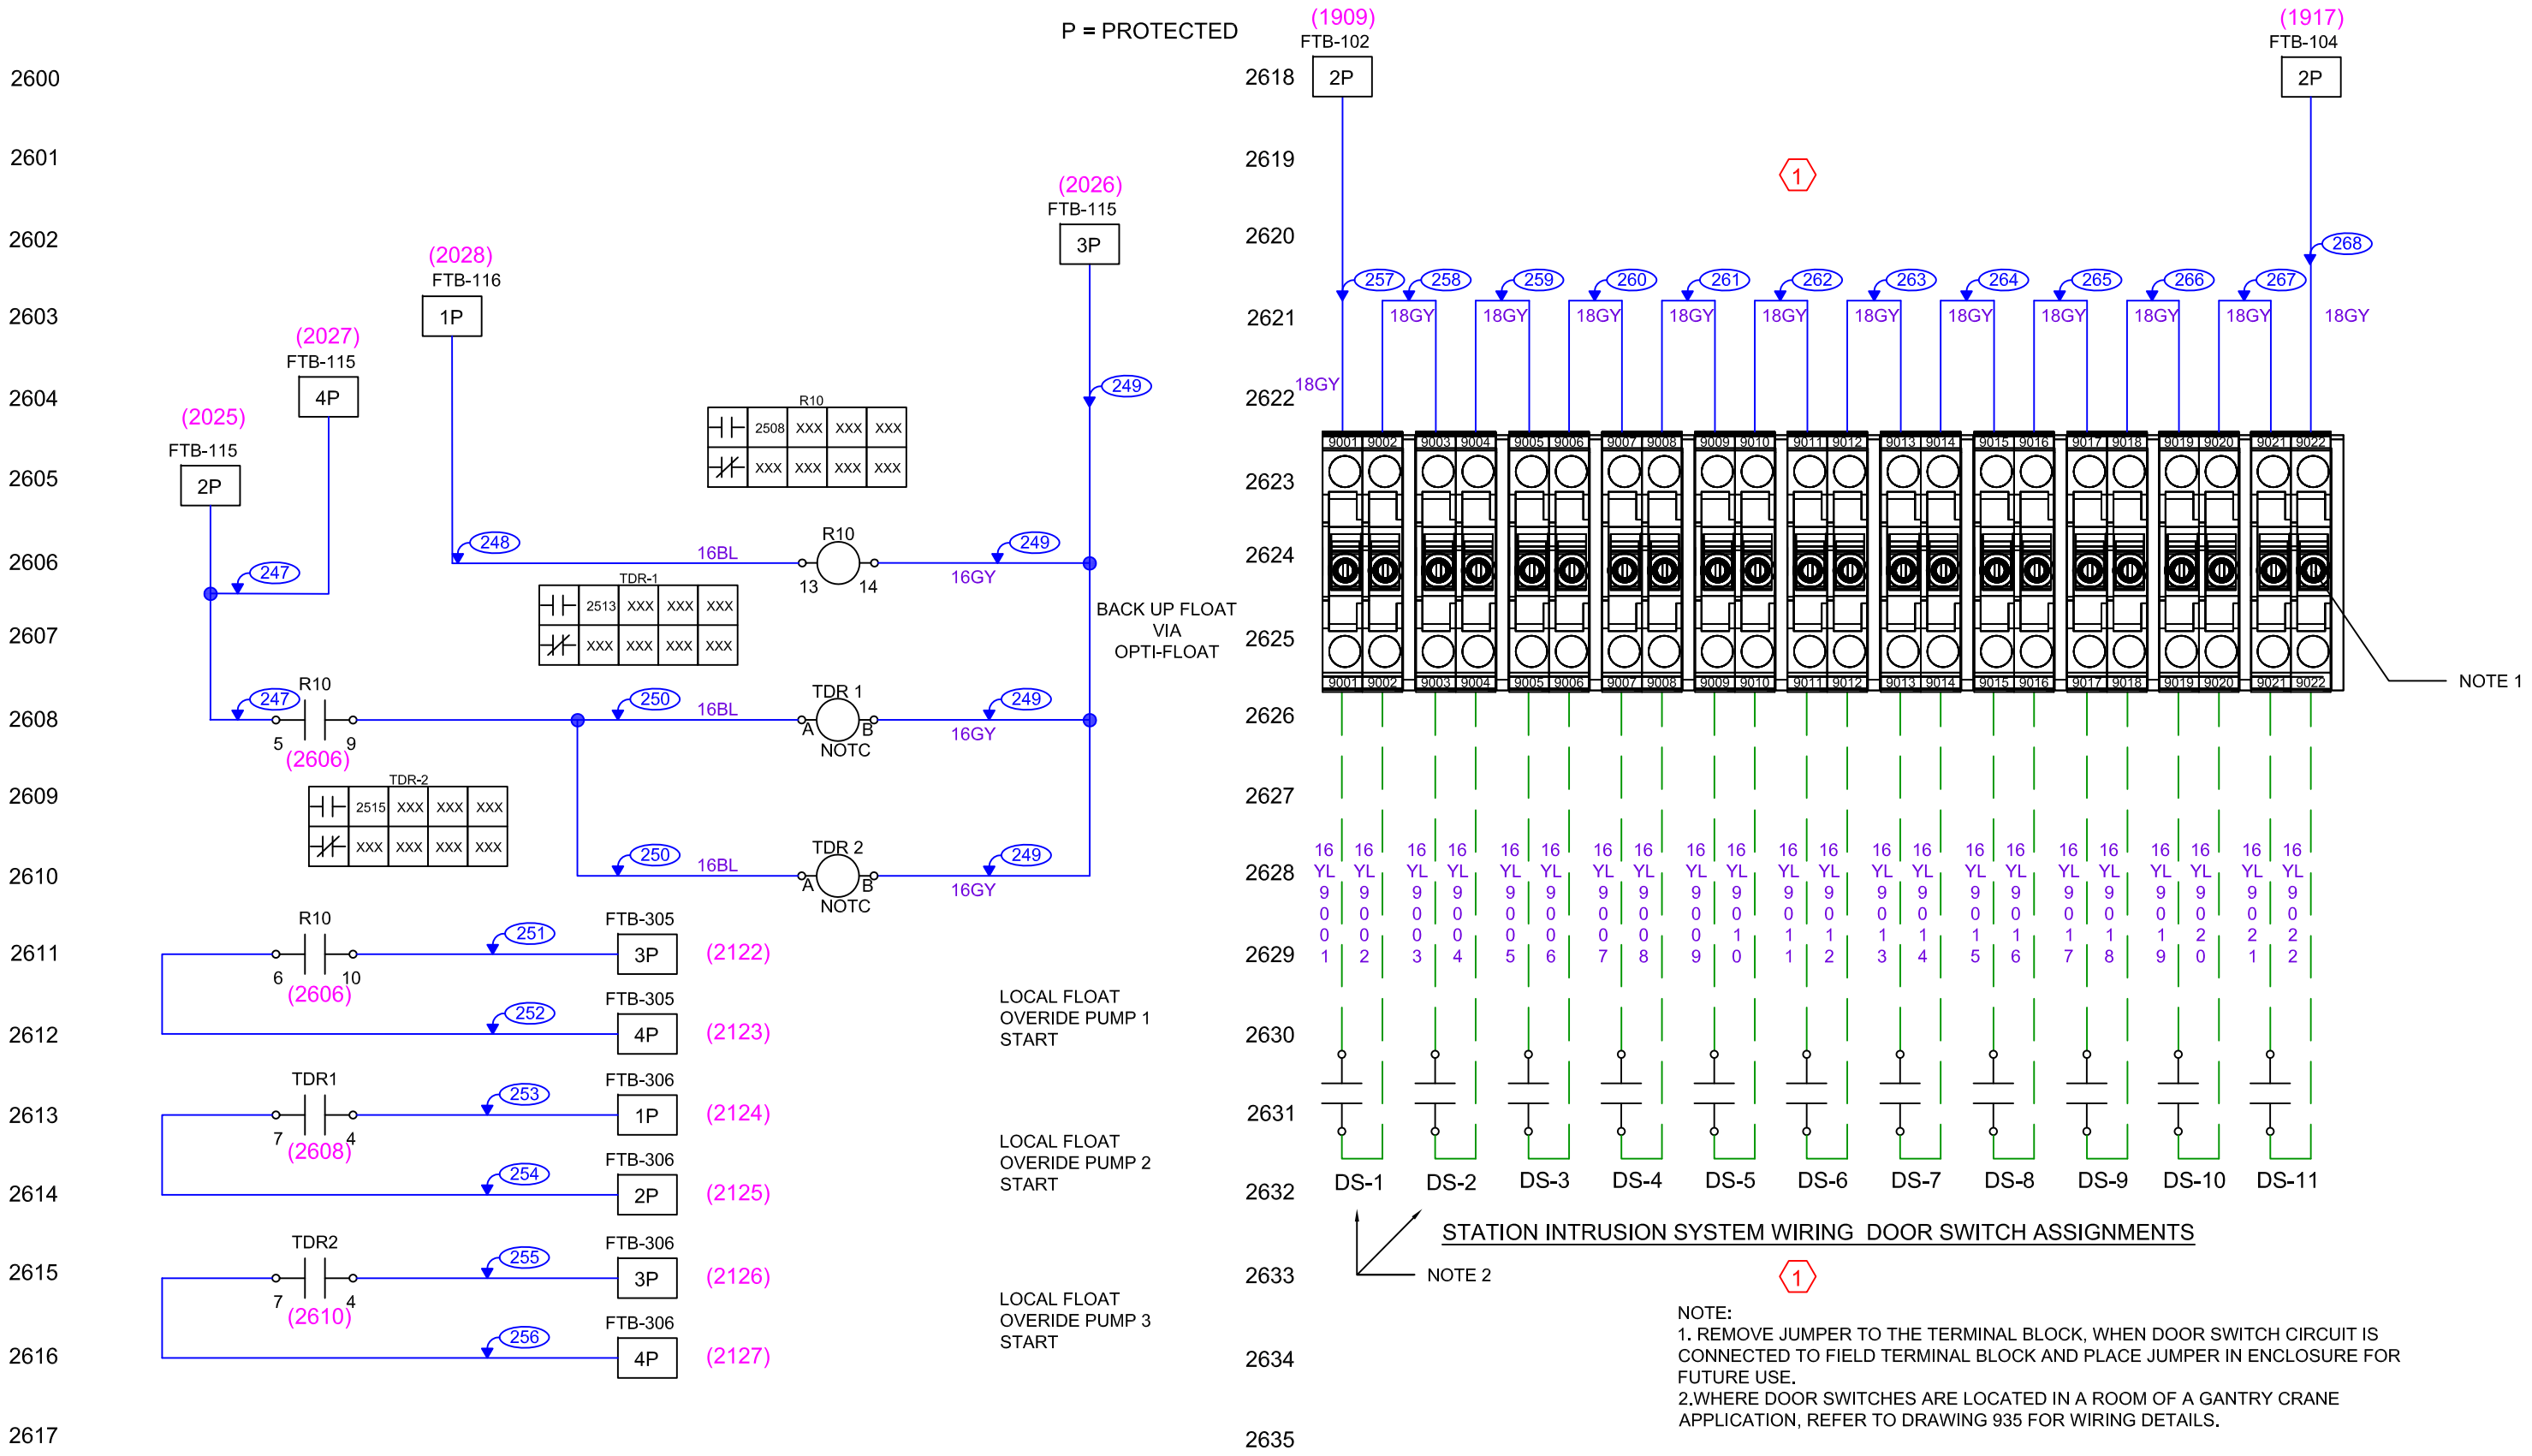

NOTE:
1. REMOVE JUMPER TO THE TERMINAL BLOCK, WHEN DOOR SWITCH CIRCUIT IS CONNECTED TO FIELD TERMINAL BLOCK AND PLACE JUMPER IN ENCLOSURE FOR FUTURE USE.
2.WHERE DOOR SWITCHES ARE LOCATED IN A ROOM OF A GANTRY CRANE APPLICATION, REFER TO DRAWING 935 FOR WIRING DETAILS.

-	ADDED FTB DRAWING NOTES AND LAYER	10-17-2013	JG
1	ADDED FTB FOR INTRUSION SYSTEM	01-28-2015	JG
1	REVISED TITLE, SHEET NUMBER AND NOTES	01-28-2015	JG
NO	REVISION	DATE	BY

SCALE: N.T.S.
DESIGN: IAG / LS
DRAWN BY: JG
APPROVED BY: WW

WASTEWATER DIVISION,
INDUSTRIAL AUTOMATION GROUP
CITY OF
ORLANDO, FLORIDA

TITLE: LIFT STATIONS STANDARDS
RTU FOR ≥ 50 HP VFD WITH SSRVS PUMP
CONTROL PANEL (PCP)
LOCAL FLOAT OVER RIDE CONTROL AND
INTRUSION SYSTEM WIRING SCHEMATICS

SHEET
626