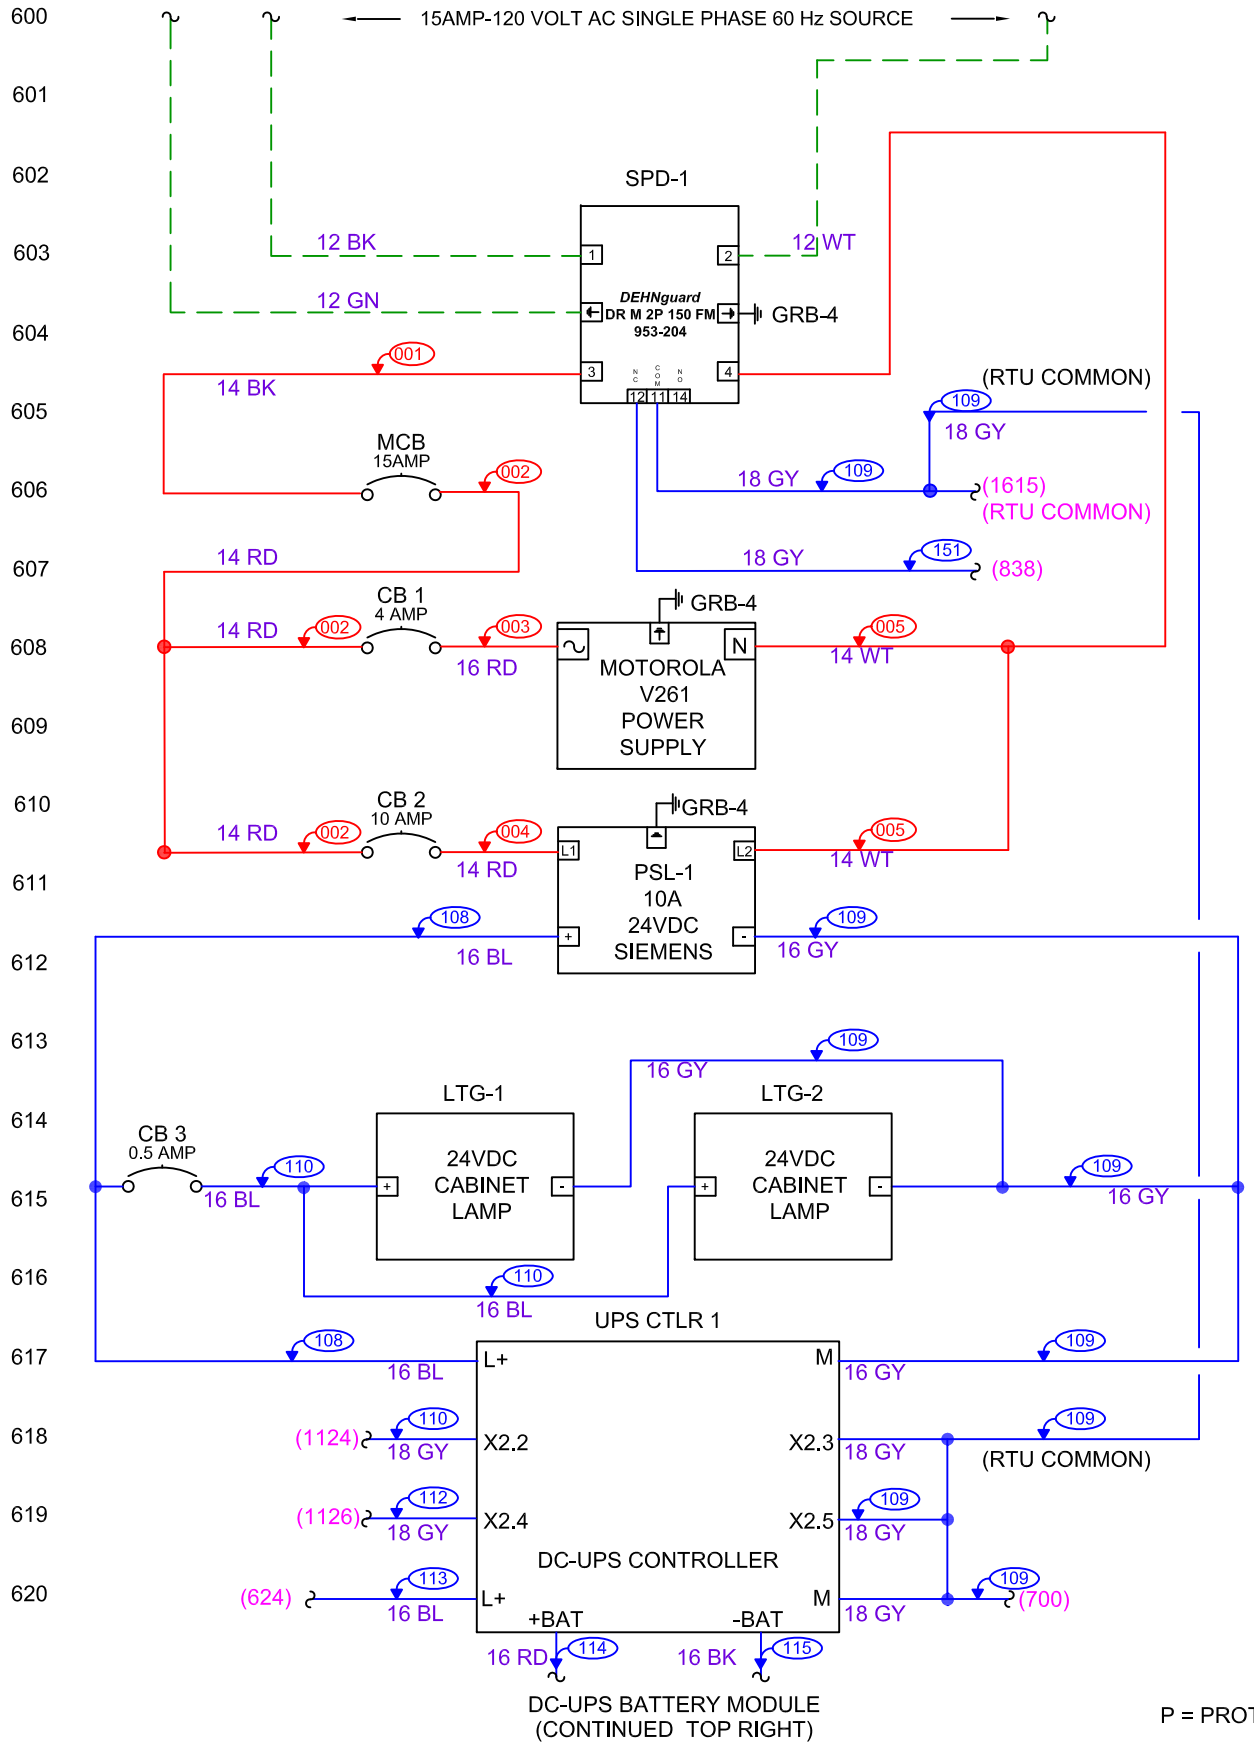

P = PROTECTED

SCALE: N.T.S.	-	ADDED FTB DRAWING NOTES AND LAYER	10-17-2013	JG	WASTEWATER DIVISION, INDUSTRIAL AUTOMATION GROUP CITY OF ORLANDO, FLORIDA
DESIGN: IAG / LS	1	ADDED LIT-1 AND REVISED LIT-2 WIRING	01-27-2015	JG	
DRAWN BY: JG	2	ADDED LIT-1 AND REVISED LIT-2 WIRING	03-04-2015	JG	
APPROVED BY: WW	3	ADDED BATTERY MODULES	06-15-2015	JG	
	4	ADD WIRING FOR ANALOG TEST POINT	10-19-2015	JG	
	NO	REVISION	DATE	BY	

TITLE: LIFT STATIONS STANDARDS
RTU FOR ≥ 50 HP VFD WITH SSRVS PUMP
CONTROL PANEL (PCP)
DISTRIBUTION WIRING SCHEMATIC

SHEET
606